



- Notes:**
- 1. This drawing is for 'Dimensional information Only', it is essential that this drawing is read in conjunction with the 'Installation Guidelines' supplied with the unit. (Copies available from our Sales Department)
 - 2. Inlet and Outlet pipes are Ø110mm PVCu.
 - 3. Extension neck kit is available for deep inverts up to a maximum invert of 2000mm. See extension neck drawing for assembly details.
 - 4. Blower located inside external housing. Alarm beacon to be fitted to outside of blower housing (if applicable).
 - 5. Vent pipe connection is supplied but vent runs and stacks are supplied by others.
 - 6. Air hose for tank internals is supplied with blower housing and is run through the vent.
 - 7. **Pea -shingle backfill is reliant on use of correct strapping and anchoring.

Unit Ref	A' (mm)	B' (mm)	C' (mm)	D' (mm)	E' (mm)	F' (mm)	G' (mm)	Unit Weight (Kgs)
BIA 6	500	600	4400	1920	2245	250	110	440
	1000	1100	4400	1920	2745	250	110	450
	1500	1600	4400	1920	3245	250	110	480
	2000	2100	4400	1920	3745	250	110	490

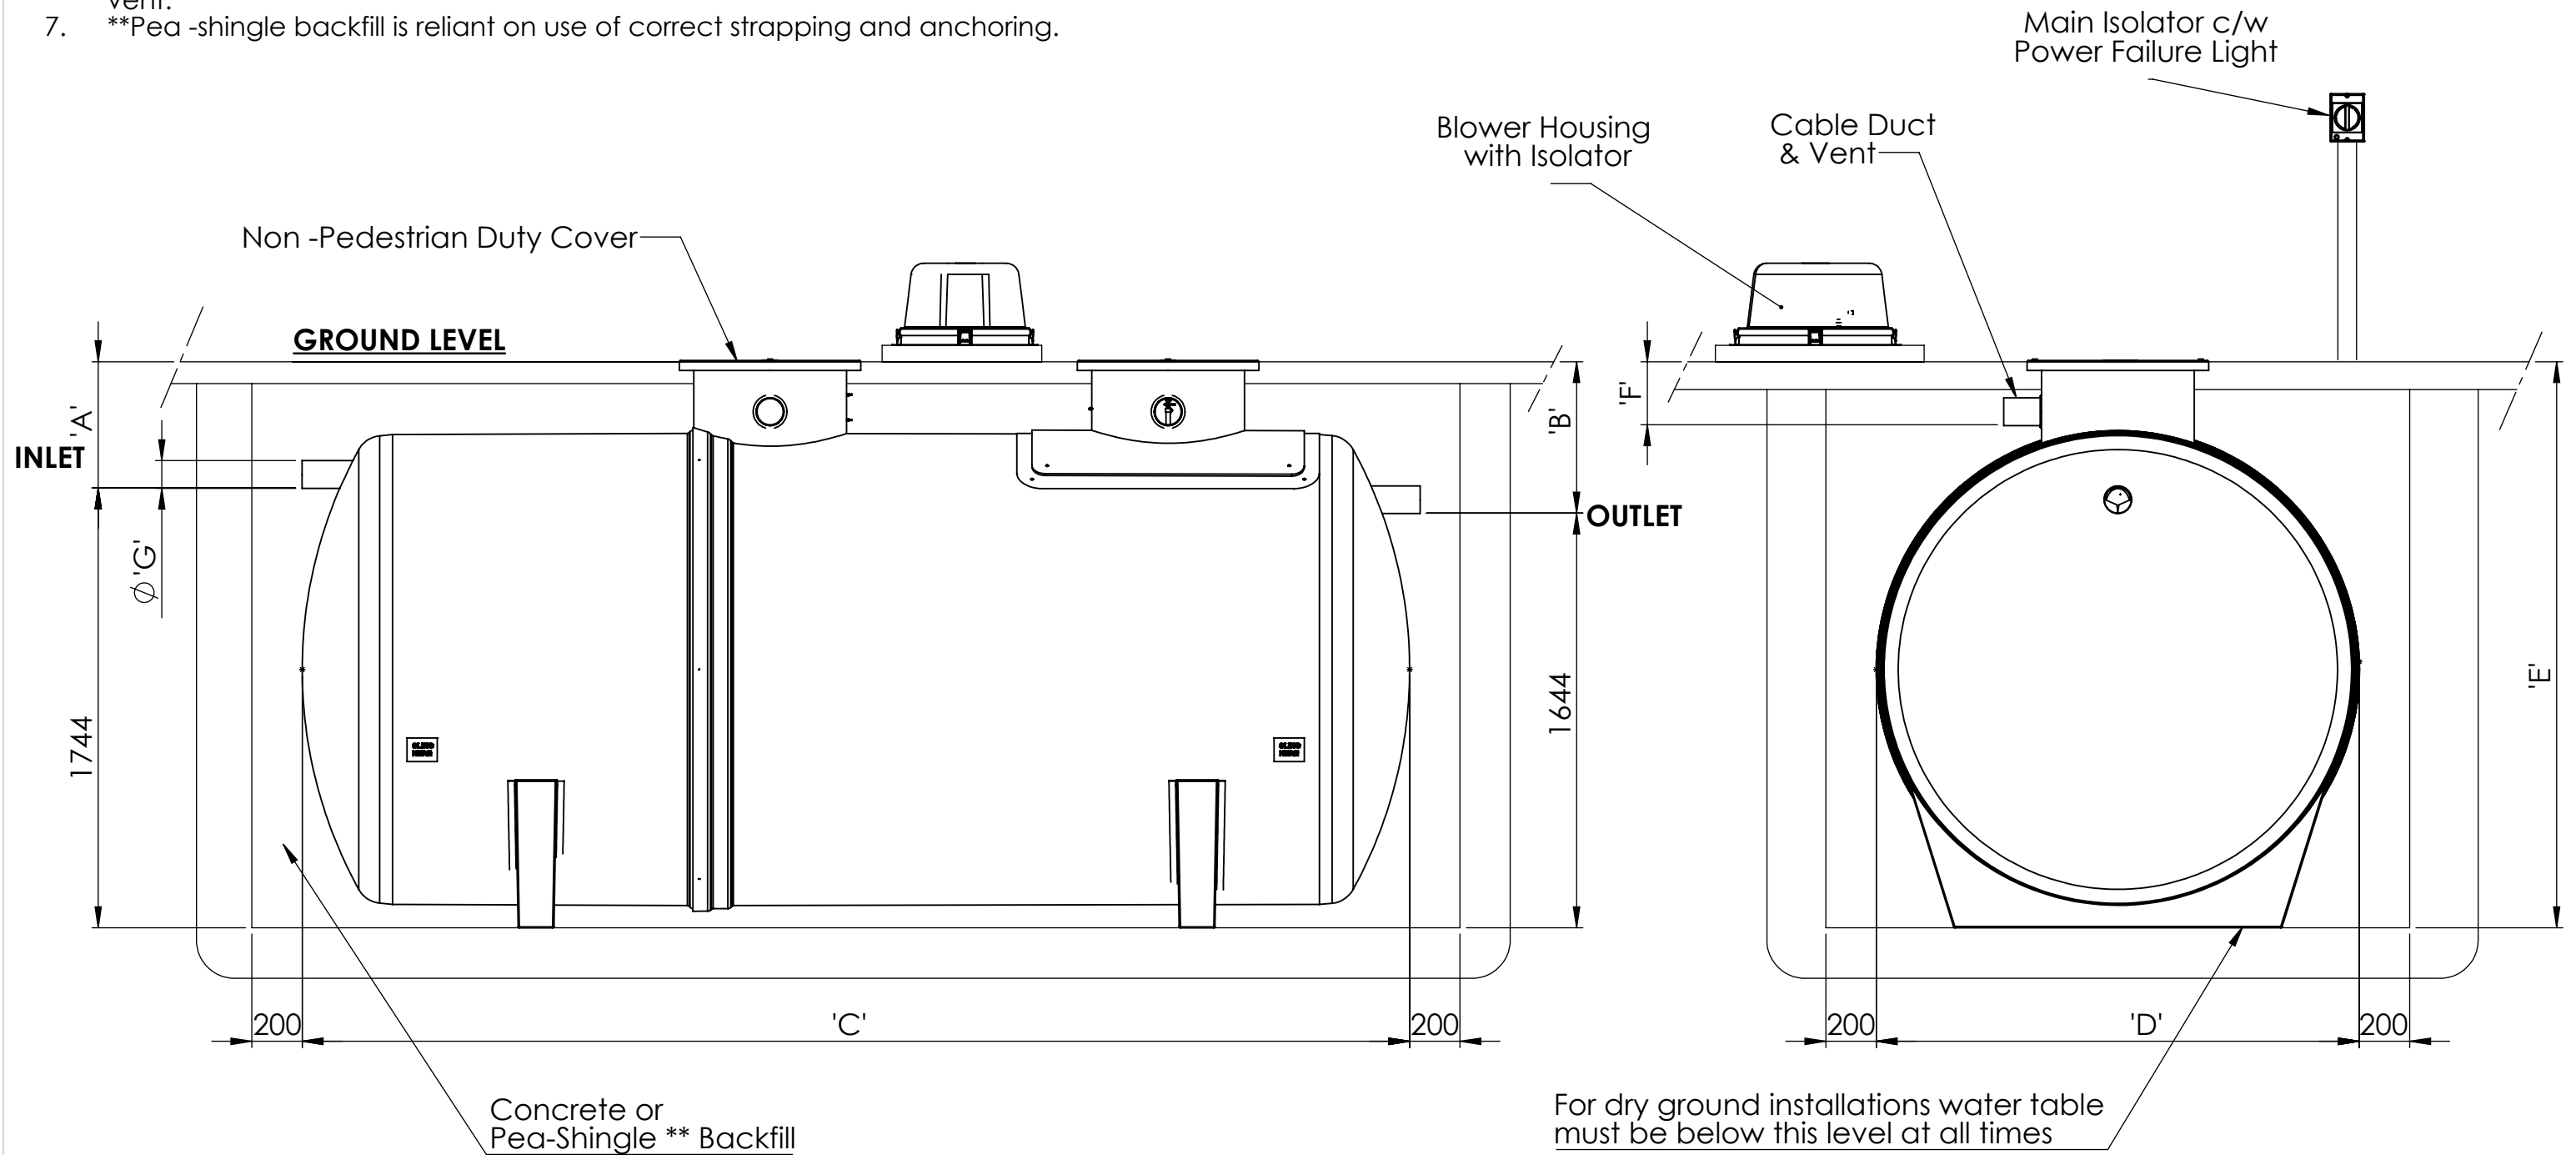

Please check with Kingspan Water & Energy for the latest Issue of the drawing					LN Number :	Tolerance : +/- 5 mm	Drawing : DS1448B	Page 1 of 1
Issue	Date	Drawn By	Approved By	Description	Finish : n/a	Thickness : n/a		
01	26/01/24	JMcM	JMcM	Initial Issue	Weight : Kgs	Surface Area : n/a	BioAir 6 (20PE) Gravity Sales Drawing	
					Modelled By :	Material : Various		
All dimensions in mm				Scale: Not to scale		<div>Clearwater reserve the right to alter the details of this drawing without prior notice. This drawing is copyright and may not be reproduced or used without the written permission of Clearwater.</div> <div></div>		
A:\Wastewater\Engineering\Engineering Projects\980A - BioAir Treatment Plant (Clearwater Brand)\Sales Drawings\DS1448B								