
## Notes:

- Pumpwell delivered with pumps installed. Control panel and Float switches attached to pallet.
  Pumps to be coupled to chains with shackles supplied on lifting chain which is connected to the unistrut assembly.
- Read Operating and Installation guidelines before installing.

Γ			Case Depth 'B'			Inlet Invert 'A'			
	Case Ø	Outlet Invert	PX2	PX3	PX4	05	11	14	Inlet Size
		Ģ	<b>10</b> (1.0m)	<b>16</b> (1.6m)	<b>19</b> (1.9m)	0.5m	1.1m	1.4m	Ē
			•			•			440
	09 (0.9m)	0.5m		•			•		110mm
					•			•	160mm

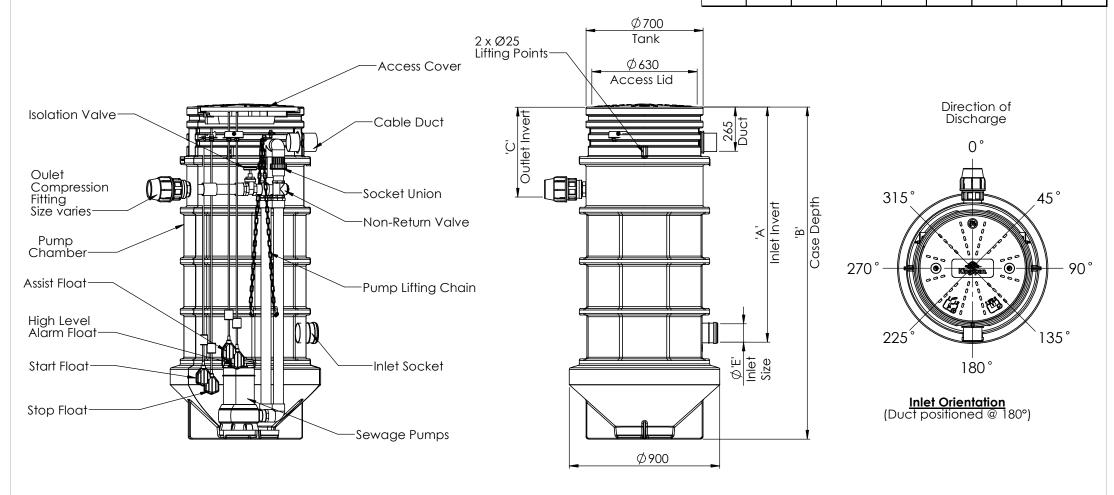

Please check with Kingspan Water & Energy for the latest Issue of the drawing							
	Issue	Date Drawn By		Approved By	Description		
	03	14/11/2024	D.Musvaburi	D.M	ECN 2147		
	02	09/10/2024	D. Musvaburi	D.M	ECN 2128		
					<u> </u>		

Scale: Do Not Scale

All Dimensions In mm

A:\Wastewater\Engineering\Drawing Data\02 - Sales Drawings\DS\DS - 14\DS1490P

<b>-</b>	
Third Angle Projection	

LN Number :

	Finish:	Thickness:				
	Weight:	Surface Area: m²				
	Modelled By:	Material:				
	Kingspan Water & Energy reserve the					
	right to alter the details of this drawing without prior notice. This drawing is copyright and may not be reproduced or used without					
_	the written permission of Kingspan Water & Energy					

Tolerance (unless stated)

Ø0.9m PE Twin Sewage Pump Chamber

Drawing: DS1490P



Page 1 of 1