



General Installation Instructions

Non- man entry inspection chambers for en1401 pipe systems


Typical installation for IC110 &160 kits with base

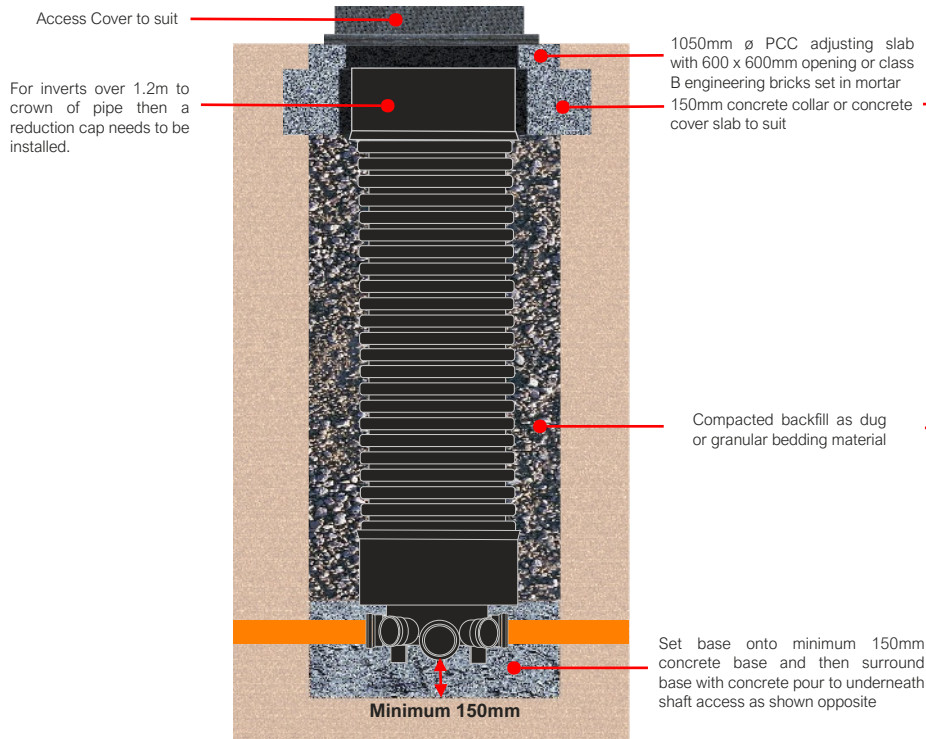

Typical installation for IC110 & 160 SP single piece units

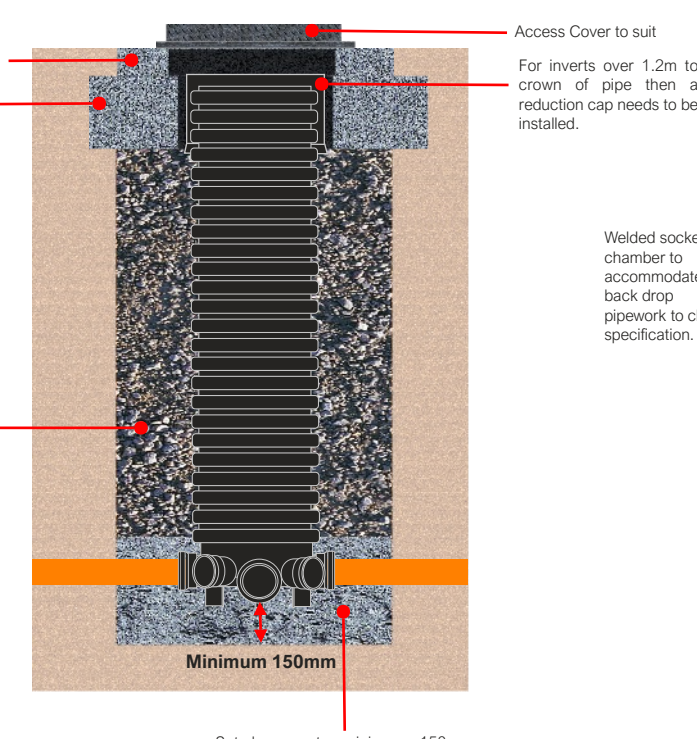

Backdrop configurations can be accommodated

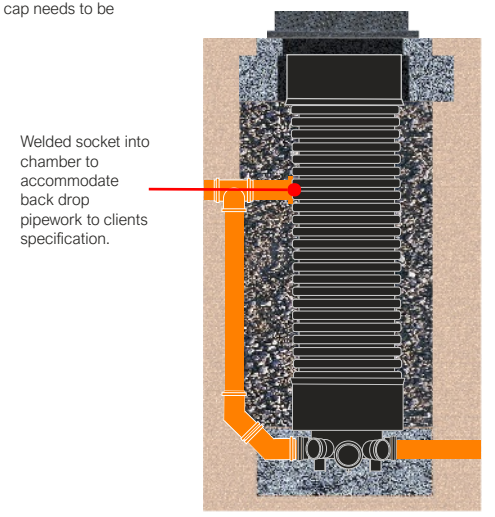

IC110&160450 range
Adoptable installations Max. Depth 3 metres cover/ground level to crown of pipe
*3 metres in non adoptable installations

IC110&160600 range
Adoptable installations Max. Depth 3m cover/ground level to crown of pipe
*6m in non adoptable installations



Unit 1 Business Village
Drum Industrial Estate,
Chester le Street DH2 1AG

Tel. 0191 3545900 & 0191 4102775
Email: sales@turtleenviro.co.uk